

## Addendum

PROJECT: Public Safety Dispatch Remodel

ADDENDUM # 1

DATE: 5/6/22

TO: ALL INTERESTED BIDDERS OF RECORD

BID NUMBER: B0027821

This Addendum # 1 forms part of the Contract Documents and modifies the original Bidding Documents. Acknowledge receipt of this addendum in the space provided on the Bid Form. Failure to acknowledge this addendum may subject Bidder to disqualification.

### GENERAL INFO

1. A Pre-Bid site visit was held May 3, 2022 at 10:00am at the Project site.
2. The Bid date remains unchanged set as May 11, 2022 at 2:00pm

### SPECIFICATION REVISIONS

1. None

### DRAWING REVISIONS

1. See R.E. Dimond and Associates Addendum # 1 included with this Addendum
2. A clarification drawing regarding motorized countertop is included with this Addendum

### QUESTION AND ANSWERS

- Q None received to date  
A

### OWNER COMMENT

1. The two Dispatch front work countertops will be in three pieces with the corner section mounted on an owner provided motorized base. ISU will provide a detailed countertop drawing as part of this addendum. The other two pieces will still require mounting brackets anchored to the walls.
2. The one new door noted to have ballistic glass will be of level 2 rating. The door will not be rated.
3. All contractor employees working in the building will be required to have a background check performed before being allowed access on site. ISU public safety will perform this background check for any Felony charges.
4. The back loading dock will be available for delivery of material and the location of a dumpster.
5. The building will remain occupied and have employees 24 hours 7 days a week working within the area. Plastic construction barriers will be required to contain the dust from the existing non construction areas to the south. Plastic construction barrier will be needed in the

IDF room while the existing wall is removed to protect the required remaining computer equipment with the space.

6. A refrigerator and a microwave will be required to be purchased and installed by the contractor. This will be purchased and installed as a cost change and billed utilizing part of the base bid allowance funding.

End of Addendum # 1

attachments

Project Name: Public Safety Dispatch Renovation  
Burford Commons  
Terre Haute, Indiana 47809

ISU Bid Number B0027821

D&A Project #21078

Date: 5/6/2022

---

This Addendum issued prior to bidding, alters, amends, corrects, or clarifies the Proposal Documents to the extent stated herein and does hereby become a part of the Proposal Documents, and will become a part of the Contract Documents of the successful bidder.

---


## **ELECTRICAL**

### **A. DRAWINGS**

1. Drawing No. T101 – First Floor Plan – Telecom & Fire Alarm
  - a. Install the Valcom fire alarm devices in IDF 121A. Interface with network as required. Provide wiring to FACP. Coordinate with JCIFP and provide all necessary components, connections, and wiring. See spec section 28 31 11.10 Addressable Fire Alarm with Addressable Speaker/Visual.
2. Drawing No. T102 – Partial First Floor Plan – Telecom & Fire Alarm
  - a. Add to Plan Note 10 – Provide an electric strike compatible with the specified lever hardware set. Connect to access control panel. Connect for fail-secure operation. Provide all necessary components and wiring.
3. Drawing No. E001 – Symbols, Abbreviations, and Notes - Electrical
  - a. Change symbols for fire alarm system horn/strobes to speaker/strobes.
  - b. Delete fire alarm ceiling speaker symbol.
  - c. Change fire alarm smoke detector, heat detector, and duct detector symbols from hexagon to circle, to match floor plan symbology.

END OF ADDENDUM

DISPATCH  
102

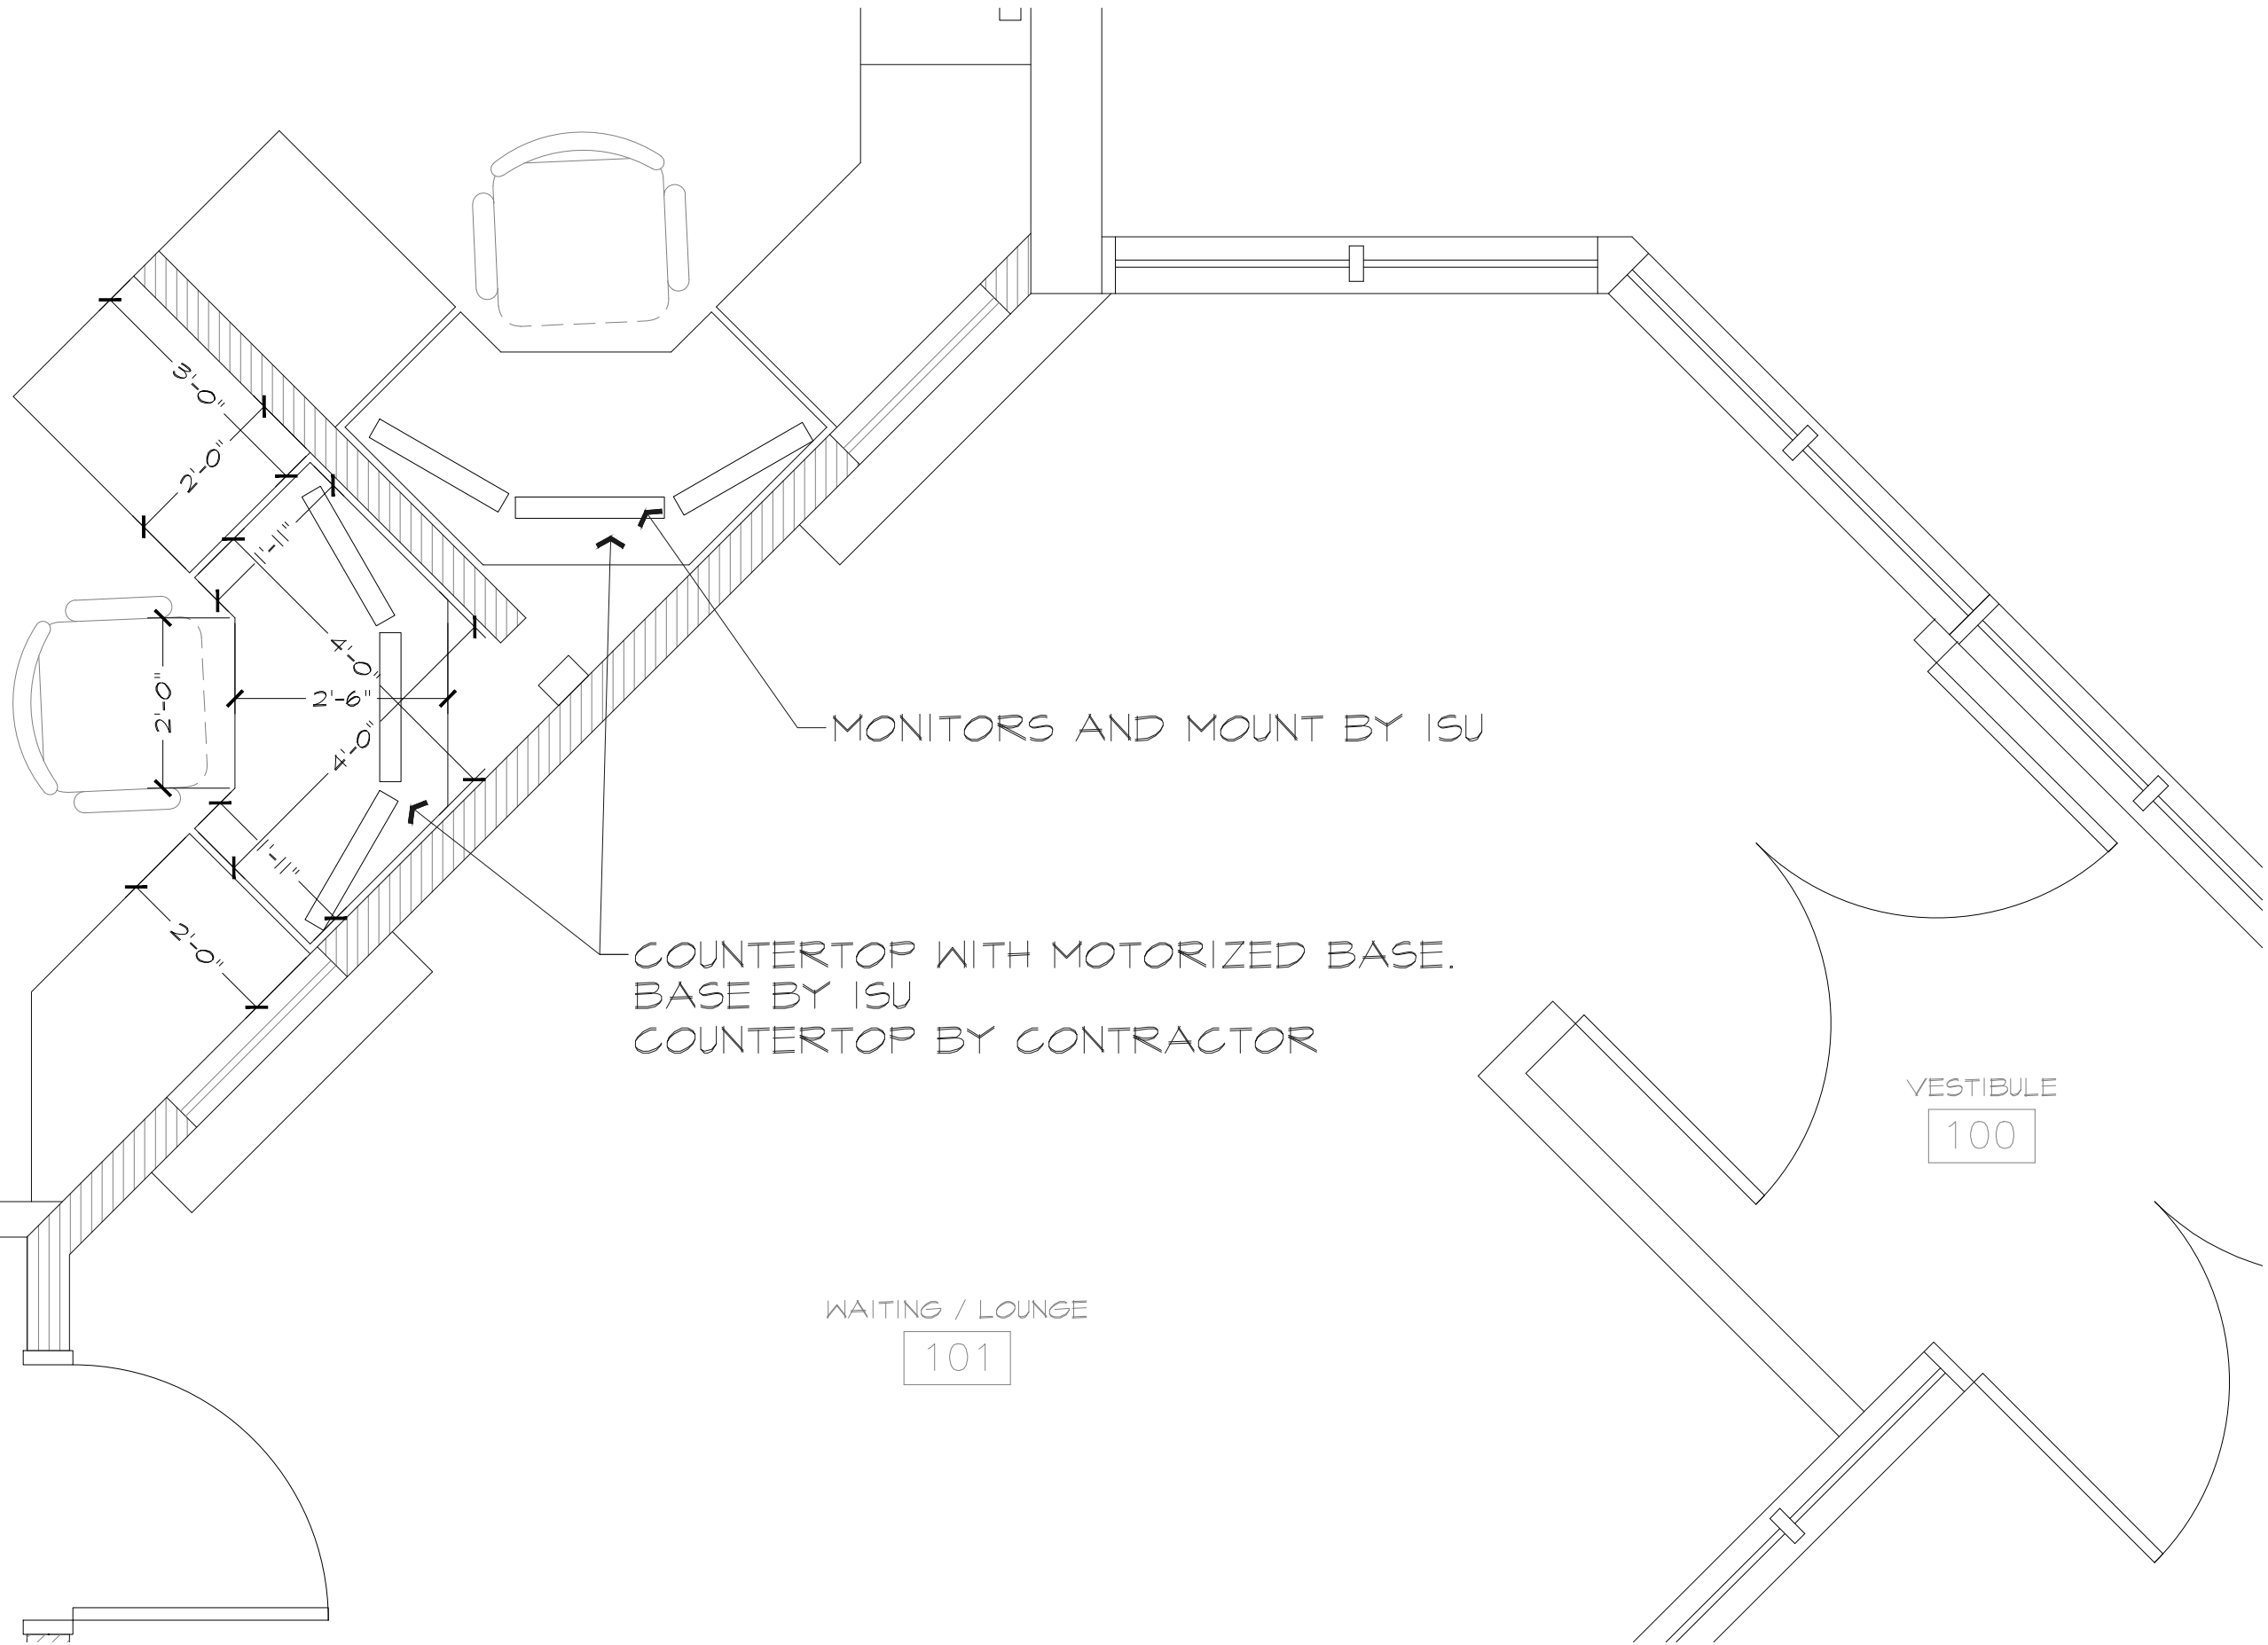

MONITORS AND MOUNT BY ISU

COUNTERTOP WITH MOTORIZED BASE.  
BASE BY ISU  
COUNTERTOP BY CONTRACTOR

WAITING / LOUNGE  
101

VESTIBULE  
100